



JUMO

Регулятор процесса

eTRON M100



www.jumo.nt-rt.ru



По вопросам продаж и поддержки обращайтесь:

Архангельск (8182)63-90-72
Астана +7(7172)727-132
Белгород (4722)40-23-64
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89
Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Казань (843)206-01-48

Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Липецк (4742)52-20-81
Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41

Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Новосибирск (383)227-86-73
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Пермь (342)205-81-47
Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78

Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Тверь (4822)63-31-35
Томск (3822)98-41-53
Тула (4872)74-02-29
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Уфа (347)229-48-12
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Ярославль (4852)69-52-93

JUMO eTRON M100

Electronic Refrigeration Controller

76mm x 36mm format



Type 701061/...

Brief description

The JUMO eTRON M100 is an electronic refrigeration controller for application in cold stores, freezer cabinets or cold displays, for connection to RTD probes Pt100, Pt1000, KTY1X-6 or KTY2X-6. The first measurement input is used to acquire the temperature of the cold store. The second measurement input acquires the evaporator temperature, and ends the defrosting process as soon as the limit for defrosting has been reached.

The measurements and parameters are shown in a 3-character backlit display.

Three relays are available for the cooling unit, the defrosting heating, and the fan.


Alarms can optionally be generated via a relay or by means of the integrated buzzer.

The switching states of the relays are indicated via yellow LEDs. Further options include a data logger with an adjustable recording interval for HACCP-compliant documentation¹, an RS485 interface, and a real-time clock. The electrical connection is made via screw terminals.

Four keys serve for instrument operation and parameterization.

A setup program and a PC interface are available as accessories, for easy parameterization from the PC, and for evaluating the data logger.

Block diagram

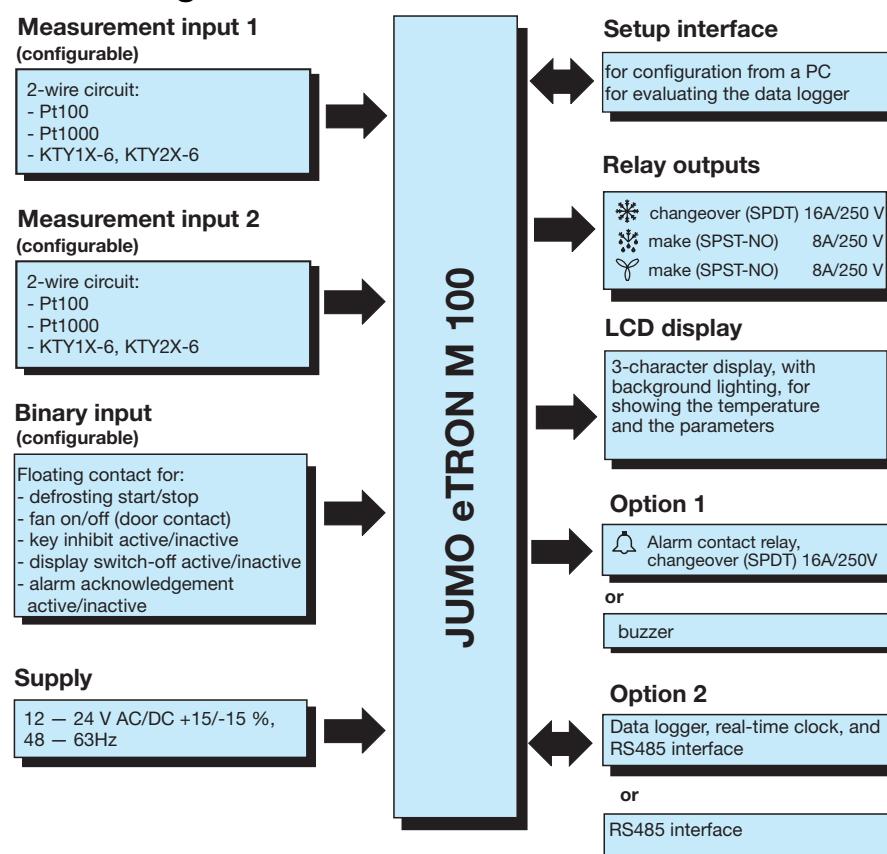

¹ HACCP : Hazard Analysis and Critical Control Point

Special features

- Choice of "electrical" or "hot gas" defrosting process
- 16A relay for cooling unit and 8A relay for defrosting and fan functions
- 2 analog inputs for RTDs, KTY1X-6 or KTY2X-6 in 2-wire circuit
- Customized linearization is programmable through the setup program
- Operating hours counter with integrated service counter
- Alarm generation via relay or buzzer
- Available with real-time clock, data logger, and RS485 interface
- The data logger records the measurement inputs and switching states of all relays. This makes it possible to implement HACCP monitoring of the cold chain.
- Up to 8 parameters can be enabled individually for the operating level
- The parameter level is protected by a code, thus preventing any unauthorized access to the instrument data.
- Meets the requirements as per EN 12830 and EN 13485
- Setup program for instrument configuration and evaluation of the data logger

Displays and controls

LCD display	3-character nine-segment display, 13 mm high, and symbols for the temperature unit, hr, min and sec, with red background lighting	
LED below the symbols	The LEDs Cooling Defrosting Fan and Alarm come on when the corresponding relay is energized. The LEDs go out when the corresponding relay is de-energized.	
Keys	(for Start/Stop of manual defrosting, acknowledge alarms (Programming (Increase parameter value (Decrease parameter value	
Setup interface	A PC interface and an adapter (4-pole socket) are used to connect the instrument to a PC.	

Technical data

Analog inputs

Analog input 1 and 2	Designation	Measuring range	Tolerance in % of measuring range span, temperature effect	Detection of ...	
				probe short-circuit	probe break
RTDs	Pt100 EN 60751	-200 to +600 °C	0.05% ($\pm 0.4^\circ\text{C}$), 100ppm/°C	yes	yes
	Pt1000 EN 60751	-200 to +600 °C	0.05% ($\pm 0.4^\circ\text{C}$), 100ppm/°C	yes	yes
PTC	KTY1X-6	-50 to +100 °C	0.5% ($\pm 0.75^\circ\text{C}$), 100ppm/°C	yes	yes
	KTY2X-6	-50 to +150 °C	0.5% ($\pm 1^\circ\text{C}$), < 100ppm/°C	yes	yes
	resistance 10 – 3500 Ω	customer table ¹	0.075% ($\pm 2.6\Omega$), 100ppm/°C	yes	yes
Measuring current for Pt100: 2 mA, for Pt1000, KTY2X-6, KTY1X-6 and resistor: 0.2 mA					
Lead compensation is adjustable via the parameter Lead compensation resistance or. 1 and or.2 . The total resistance at the analog input (probe resistance + selected value for or.1 or or.2) must not exceed the following values: 314Ω (with Pt100), 3140Ω (with Pt1000), 2235 Ω (with KTY2X-6), and 3400Ω (with KTY1X-6).					
Input resistance	$R_{IN} \geq 100\text{k}\Omega$				
Sampling time	250 msec				
Input filter	1st order digital filter; filter constant adjustable from 0.1 to 99.9 sec				
Measuring current	with Pt100: 0.2mA, with Pt1000, KTY2X-6, KTY1X-6 and resistor: 0.02mA				
Lead compensation	adjustable via the parameters Lead compensation resistance or. 1 and or.2				
Temperature offset	adjustable via the parameters or. 1 and or.2				
Special features	temperature indication switchable to °F (Fahrenheit)				

¹ A valid customer table must be entered through the setup program and switched over to **or. 1** in the instrument.

Environmental influences

Ambient temperature range	0 to 55 °C
Storage temperature range	-40 to +70 °C
Climatic conditions	≤ 85 % rel. humidity, no condensation
Shock und vibration	DIN EN 60068-2-6 schedule C.2, Frequency-Range: 10 to 55 Hz Acceleration: 20 m/s ² (2g)
Care of the front panel	The front panel can be cleaned with normal commercial washing, rinsing and cleaning agents. Do not use any solvents such as methylated spirits, white spirit, P1 or xylol !

Output

Relay for cooling, changeover (SPDT)	70 000 operations at 16A, 250V AC, 50Hz resistive load
Relay for alarm, changeover (SPDT)	60.000 operations at 16A, 250V AC, 50Hz cos phi > 0,6
Relay for defrosting, make (SPST-NO)	100 000 operations at 8A, 250V AC, 50Hz resistive load
Relay for fan, make (SPST-NO)	85.000 operations at 8A, 250V AC, 50Hz cos phi > 0,6

RS485 interface

Maximum baud rate	38.4 kbaud
Maximum transmission length	< 1200m
Maximum number of stations	32
Priority	The RS485 must not be used while the setup interface is in operation !

Supply voltage

Supply voltage	12 – 24V AC/DC +15/-15 %, 48 – 63Hz (for operation with SELV circuits only !) (not electrically isolated from the analog inputs)
Power consumption	< 3W

Housing

Material	polycarbonate, silver gray RAL 7001
Mounting	in panel cut-out, with bezel seal
Operating position	unrestricted
Weight	approx. 160g
Enclosure protection to EN 60 529, IEC 529	IP65 front, IP20 rear
Flammability class	UL 94 V0

Electrical data


Data backup	The data sets of the data logger are saved to a flash memory. The adjustable parameters are stored in EEPROM. Data are preserved after a power interruption.	
Data logger: Recording duration depending from Recording interval (Parameter rEC)	rEC	Recording duration
	1 min	7 days 19 hours
	5 min	39 days (1 month, 9 days)
	15 min	117 days (4 month)
	60 min	469 days (1 year 3 months)
	120 min	938 days (2 years 6 months)
Connection circuit	screw terminals for wire cross-sections up to 4 mm ² , solid wire, up to 2.5 mm ² , stranded wire	
Electromagnetic compatibility interference emission interference immunity	Product family standard: EN 61326 Class B to industrial requirements	
Operating conditions	The instrument is designed as a panel-mounting unit.	
Electrical safety	EN 60 730, Part 1, overvoltage category III, pollution degree 2	
Accuracy of the real-time clock, buffering	at 25°C: +15/- 15 sec per month, temperature effect: - 0.35 ppm/10°C within the ambient temperature range: +60/- 60 sec per month Gold Cap capacitor buffers the clock time unpowered for about 20 days.	
Technical and functional characteristics of temperature recording devices or thermometers	as per EN 12830 and EN 13485	

Approval/Marks

Abbreviation	Inspection authority	valid for
UL	Underwriters Laboratories	only valid for mass-production units with the JUMO symbol


Connection diagram

Type 701061/XXX-XX

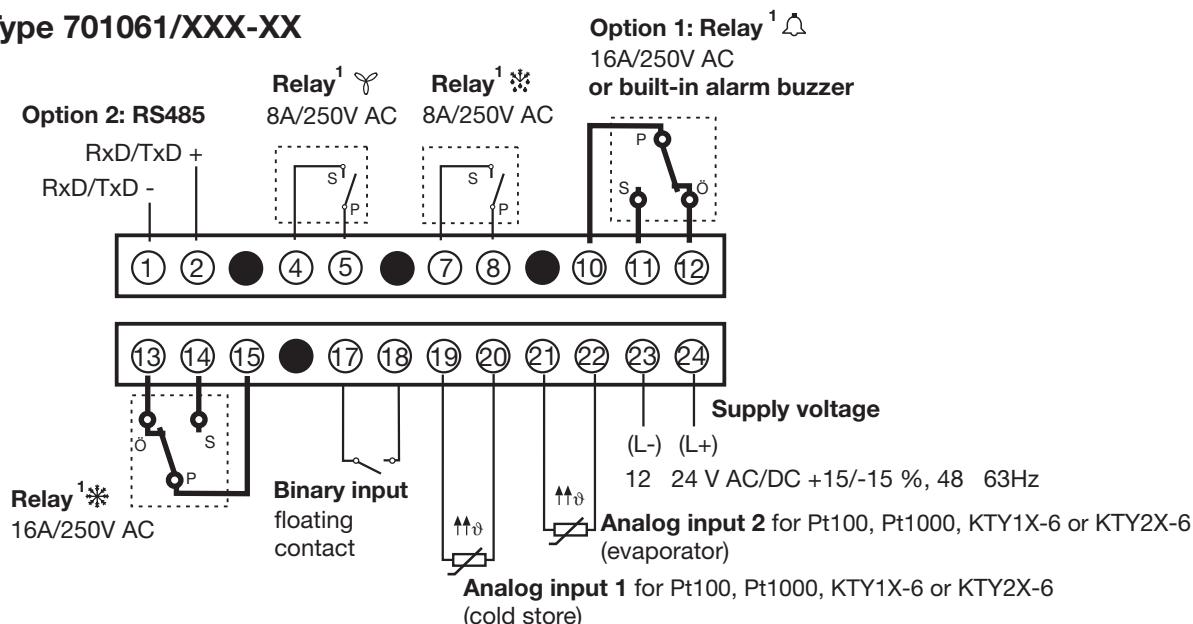


Dimensions

Type 701061/...

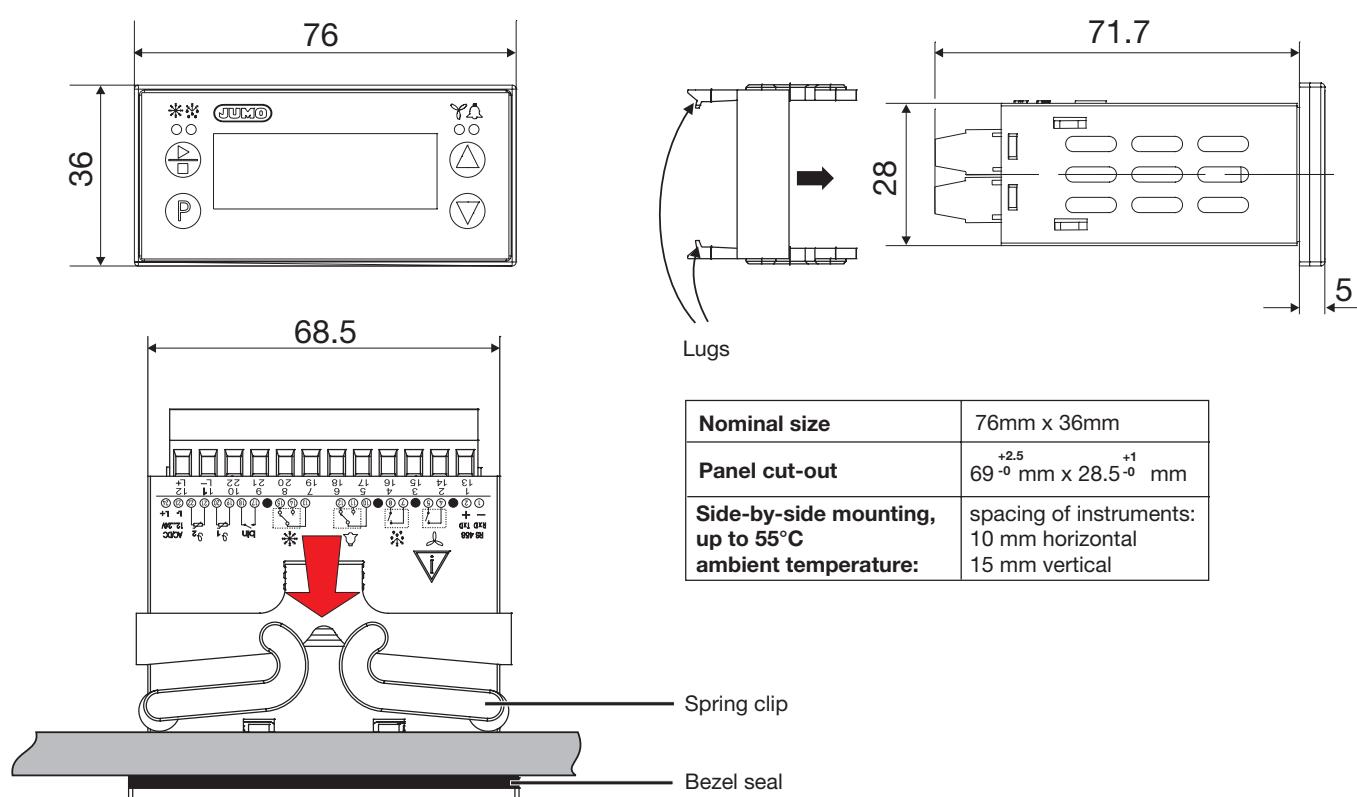


Controller functions

Cooling, defrosting and fan functions

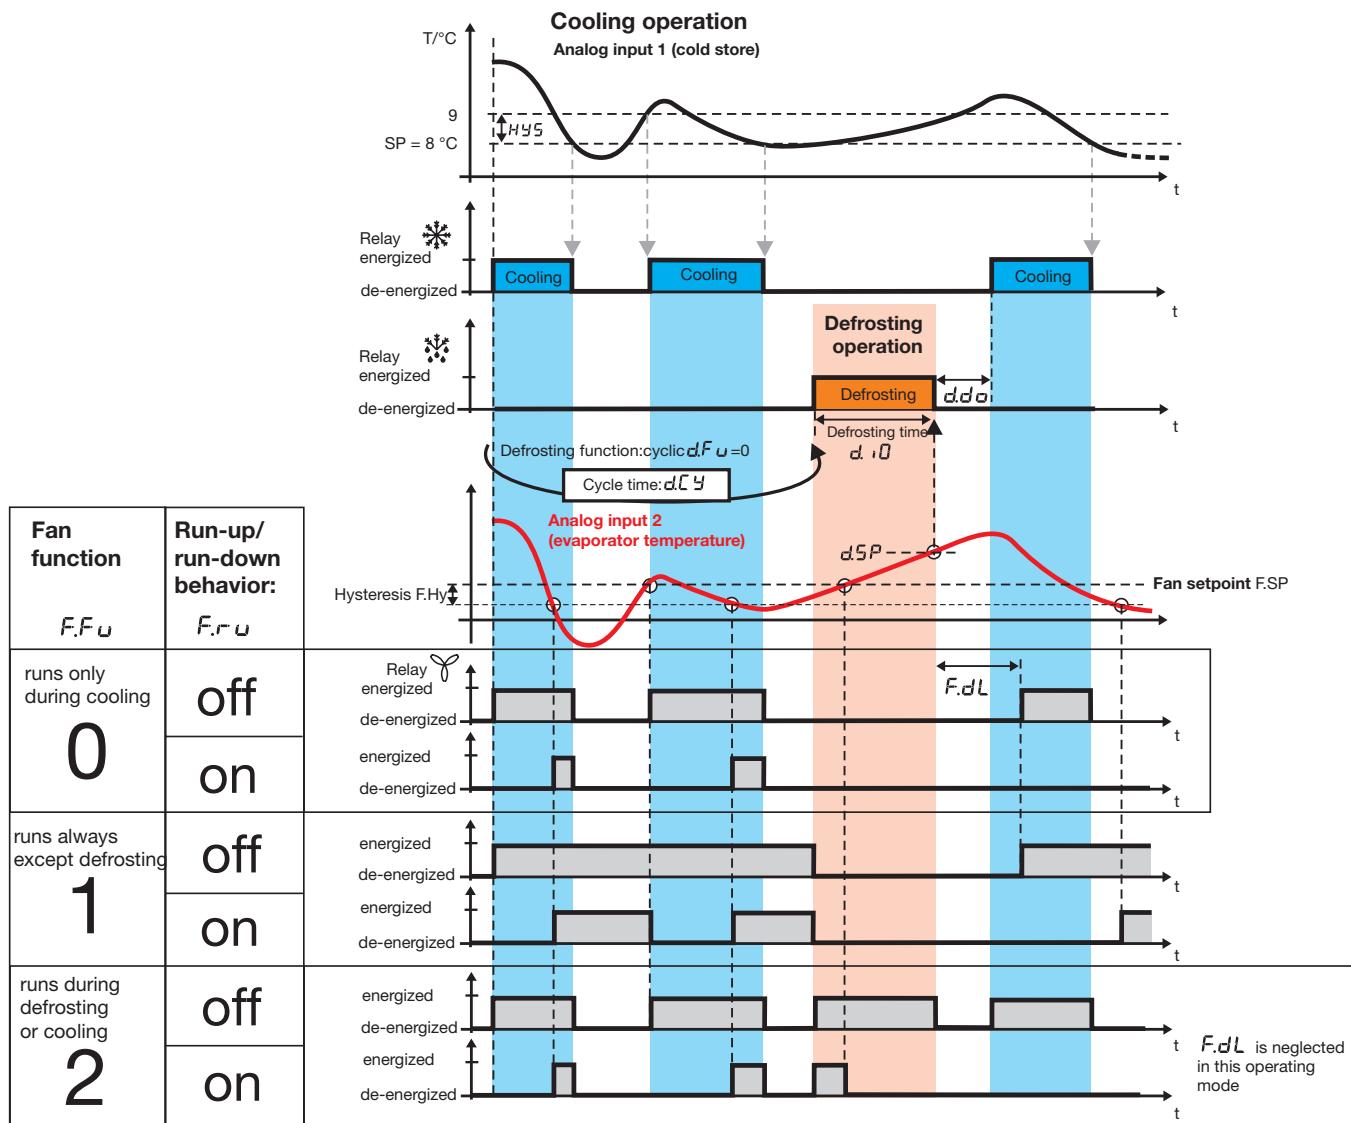

Special function: cooling and heating with fan relay

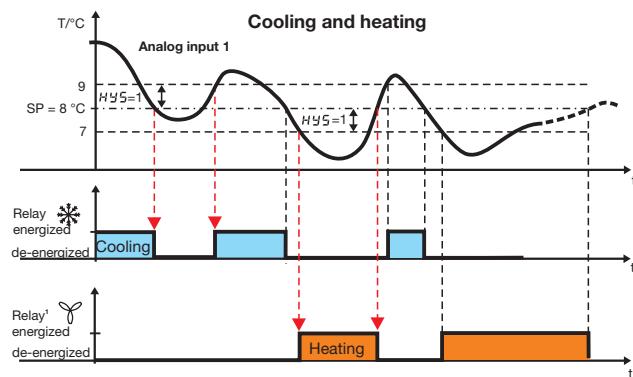

Order details

	(1) Basic version
701061	JUMO eTRON M100 with 2 measurement inputs and 3 relay outputs
x 8	(2) Basic type extensions factory-set, configurable
x 9	configuration to customer specification
	Option 1
x 0	not available
x 1	buzzer
x 2	alarm contact, changeover (SPDT) contact 16A/250V
	Option 2
x 0	not available
x 1	RS485 interface
x 2	data logger, real-time clock, and RS485 interface
	(3) Supply voltage
x 32	12 – 24V AC/DC +15/-15 %, 48 – 63Hz
	(4) Extra codes
x 000	no Pt100 push-in probe
x 236	2 Pt100 push-in probes (diameter: 6mm, fitting length: 50mm, connecting cable: 1500mm)

Order code (1) (2) (3) (4)
Order example 701061 / 8 0 0 - 32 / 000

2 Pt100 push-in probes (extra code 236)



Standard accessories

- 1 Operating Manual
 - 1 spring clip and bezel seal

Accessories - Price Sheet 70.9770

Setup program, multilingual

PC interface with USB/TTL converter, adapter (socket) and adapter (plug)

PC interface TTL / RS232 converter and adapter (socket)

Accessories - Price Sheet 70.9710

Adapter frame for mounting on DIN rail



По вопросам продаж и поддержки обращайтесь:

Архангельск (8182)63-90-72
Астана +7(7172)727-132
Белгород (4722)40-23-64
Брянск (4832)59-03-52
Владивосток (423)249-28-31
Волгоград (844)278-03-48
Вологда (8172)26-41-59
Воронеж (473)204-51-73
Екатеринбург (343)384-55-89
Иваново (4932)77-34-06
Ижевск (3412)26-03-58
Казань (843)206-01-48

Калининград (4012)72-03-81
Калуга (4842)92-23-67
Кемерово (3842)65-04-62
Киров (8332)68-02-04
Краснодар (861)203-40-90
Красноярск (391)204-63-61
Курск (4712)77-13-04
Липецк (4742)52-20-81
Магнитогорск (3519)55-03-13
Москва (495)268-04-70
Мурманск (8152)59-64-93
Набережные Челны (8552)20-53-41

Нижний Новгород (831)429-08-12
Новокузнецк (3843)20-46-81
Новосибирск (383)227-86-73
Орел (4862)44-53-42
Оренбург (3532)37-68-04
Пенза (8412)22-31-16
Пермь (342)205-81-47
Ростов-на-Дону (863)308-18-15
Рязань (4912)46-61-64
Самара (846)206-03-16
Санкт-Петербург (812)309-46-40
Саратов (845)249-38-78

Смоленск (4812)29-41-54
Сочи (862)225-72-31
Ставрополь (8652)20-65-13
Тверь (4822)63-31-35
Томск (3822)98-41-53
Тула (4872)74-02-29
Тюмень (3452)66-21-18
Ульяновск (8422)24-23-59
Уфа (347)229-48-12
Челябинск (351)202-03-61
Череповец (8202)49-02-64
Ярославль (4852)69-52-93